

#### Features

##### Remote multi-line expanded content display interface for Simplex® 4010ES Series fire alarm control panels:

- Remote InfoAlarm Command Centers that mount in a dedicated cabinet
- 4010ES control panels support Remote InfoAlarm Command Centers independent of host panel display type
- UL listed to Standard 864

##### InfoAlarm Command Centers provide customized operating convenience:

- “Activity in System” primary display choices include: First and Most Recent, First 5 and Most Recent, First 8, Site Plan with activity status icons, General Alarm, or Direct to List; selectable individually by event type
- System reports are easily viewed; logs can be read with minimal scrolling required
- Up to six “softkeys” per screen provide functions that vary with the particular screen information aiding operators to determine how to proceed
- Up to two languages are available per system, easily selected by programmable key press (systems with IMS/GCC/NPU or 2 x 40 LCD panels or annunciators require one language to be the default font)
- International models allow customized language legends for operator keys and status LEDs
- Information sent to Remote InfoAlarm Command Centers can be vectored by point

##### Display properties:

- 320 x 240 dot matrix (QVGA) display provides an active area of 4.53” W x 3.4” H (115 mm x 86 mm) displaying up to 854 characters using standard ASCII character font
- Bright white LED backlighting provides efficient and long lasting illumination; operation is selectable as continuous or off with power fail or with no key presses

#### Introduction

**Displaying more information.** The InfoAlarm Command Center provides an expanded content, multi-line LCD interface that requires minimal key presses to access detailed information. Because it is system-powered, its detailed information is provided without requiring separate supplementary equipment.

**InfoAlarm Command Center Control Panel.** By using a larger area format instead of an individual text line display, the LCD provides text information for Alarm, Priority 2, Supervisory, or Trouble. The format is flexible and able to be customized per application allowing additional information to be presented to suit the specific application.



InfoAlarm Command Center in Remote Cabinet

#### Description

Remote InfoAlarm Command Centers for 4010ES fire alarm systems provide a large display with extended information content, dual language support including 2 byte character languages, and an intuitive control key interface per the following:

- Up to 10 Remote InfoAlarm Command Centers are supported per 4010ES control panel; able to allow one InfoAlarm Command Center to take-control and to designate access levels for interfaces not in-control; LEDs can be programmed for in-control status indications
- Menu-driven format conveniently prompts operators for the next action required
- Key controls are provided to select the highlighted entry, load next screen of information, or jump to top or bottom of activity lists
- Direct point callup displays individual points alphabetically and then homes in on the logical choice as more point information is entered
- A Site Plan bitmap can be displayed for reference; icons can be added to indicate system status
- Up to 50 custom point detail messages can be generated
- Date formats are either MM/DD/YY or DD/MM/YY
- Time formats are either 24 hour or 12 hour with AM/PM
- System Normal screen supports a gray scale bitmap (watermark) for location name, company logo, or site plan

\* This product has been approved by the California State Fire Marshal (CSFM) pursuant to Section 13144.1 of the California Health and Safety Code. See CSFM Listing 7165-0026:251 for allowable values and/or conditions concerning material presented in this document. It is subject to re-examination, revision, and possible cancellation. NYC Fire Dept COA #6095. Additional listings may be applicable; contact your local Simplex product supplier for the latest status. Listings and approvals under Simplex Time Recorder Co. are the property of Tyco Fire Protection Products.

# User Interface Operation Reference

**NOTE:** Refer to page 5 for international InfoAlarm user interface reference information

**THREE PROGRAMMABLE LEDs** provide custom labeling, the top two LEDs are selectable as red or yellow, the third LED is selectable as red or green

**ULC SYSTEMS** require designating a Ground Fault indicator

Custom label insert (typical choices shown for reference)

**320 x 240 DOT MATRIX DISPLAY**, White LED backlighting provides easy viewing; operation is programmable for key inactivity timeout and/or AC power fail


**PRIMARY "ACTIVITY IN SYSTEM" DISPLAY OPTIONS:** Choices include "First 8" (shown below for "Fire Alarm in System"), "First and Most Recent," "First 5 and Most Recent," "Site Plan," "General Alarm," or "Direct to List." After the event is acknowledged, screen reverts to the sequential event list until Ctr/Exit softkey is selected or after timeout (~ 30 seconds); applicable to Fire Alarm, Priority 2 Alarm, System Supervisory, and System Trouble, each category is independently selectable for primary display mode

**SIX SOFT KEYS** are available when required. This sample provides **Menu** to call up the available operations; **More Info** to call up specific point details, **Site** to call up the Site Plan Graphic Screen, **Event Time** (while pressed) displays time and date for all displayed events, and **Ctrl/Exit**; the following are other typical soft keys:

Point Enable and Disable  
Force On or Arm  
Force Off or Disarm  
Return On/Off or  
Arm/Disarm to Auto Mode  
Event Time Request  
More Information Request

**NUMERIC KEYPAD** for point category and point selection (alphabet characters are not used at this time)

**C/Exit Key** duplicates the **Ctrl/Exit** softkey when present

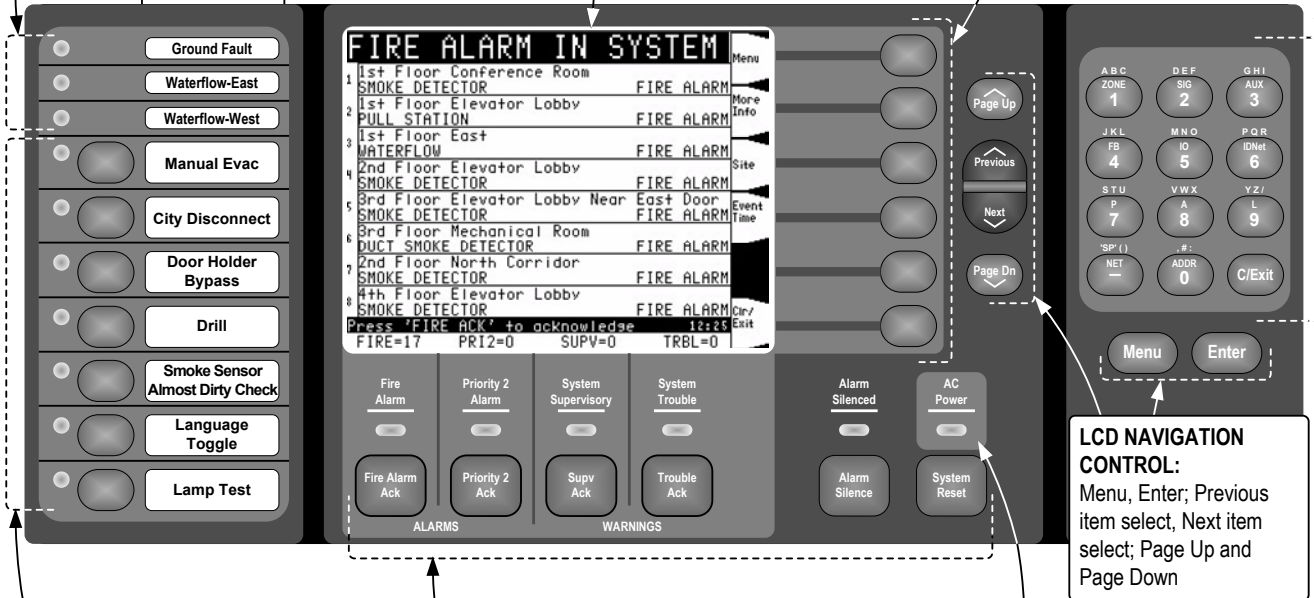

**SEVEN PROGRAMMABLE FUNCTION SWITCHES**, each equipped with dual color LED indicators; the top six LEDs are selectable as either red or yellow, the bottom LED is selectable as either red or green; **NOTE: Program the bottom switch as "Lamp Test" for UL listed systems**

**FIRE ALARM ACK** acknowledges a Fire Alarm condition, logs the acknowledge, silences the operator panel and all annunciator tone-alerts, and displays sequential alarm list

**PRIORITY 2 ACK** acknowledges a Priority 2 Alarm condition, logs the acknowledge, silences the operator panel and all annunciator tone-alerts, and displays sequential Priority 2 alarm list

**SUPV ACK** acknowledges system supervisory conditions, logs the acknowledge, silences the operator panel and all annunciator tone-alerts, and displays sequential supervisory condition list

**TROUBLE ACK** acknowledges system troubles, logs the acknowledge, silences the operator panel and all annunciator tone-alerts, and displays sequential trouble list

**ALARM SILENCE** causes audible and visible notification appliances to be silenced (default operation, may be modified through panel programming for compliance with local requirements)

**SYSTEM RESET** restores control panel to normal when all alarmed inputs are returned to normal

**SIX SYSTEM STATUS INDICATOR LEDs** provide system status indications in addition to LCD information, LEDs flash to indicate the condition and then when acknowledged, remain on until reset:

Fire Alarm & Priority 2 Alarm, red LED  
Supervisory & Trouble, yellow LED  
Alarm Silenced, yellow LED  
AC Power, green LED (on for normal)

**LCD NAVIGATION CONTROL:** Menu, Enter; Previous item select, Next item select; Page Up and Page Down

**Display Feature Reference (shown actual size)**

**FIRST OCCURRENCES (UP TO 5) AND MOST RECENT OCCURRENCE, ACTIVITY IN SYSTEM DISPLAY** ("Fire Alarm in System" screen shown for reference, see page 2 for a First 8 Events display)  
**FIRST OCCURRENCE** advises of the time, date, device type, and custom label of the first occurrence of the event type displayed; the numerical count identifies the sequence of occurrence; when selected as the primary display screen, display of first occurrence and most recent occurrence is maintained until events are acknowledged which brings up the event list (similar to the First 8 display); the display reverts back to "First and Most Recent" when the Clr/Exit softkey is selected or after a time delay

**FONT ATTRIBUTES** include:  
 Normal, **Bold**, Underline, **Double**, Dim, **Reverse**, Flash On/Off, Flash On/Dim, and commands for Vertical and Horizontal Placement

**SOFT KEYS** in this column correspond to the panel pushbutton switches; programming allows the soft keys to appear only when the functions are enabled

**DISPLAY SIZE:**  
 4.53" W x 3.4" H  
 (115 mm x 86 mm)

The screenshot shows a monochrome display with the following content:

- Header:** FIRE ALARM IN SYSTEM
- Section 1:** FIRST OCCURRENCE - 11:43 AM 10/13/14
- Event List 1:**
  - 1 North Basement - Area C SMOKE DETECTOR FIRE ALARM
  - Basment Sprinklers WATERFLOW FIRE ALARM
  - 2 1st Floor Elevator Lobby SMOKE DETECTOR FIRE ALARM
  - 3 2nd Floor East Corridor SMOKE DETECTOR FIRE ALARM
  - 4 3rd Floor Elevator Lobby SMOKE DETECTOR FIRE ALARM
  - 5
- Section 2:** MOST RECENT - 12:21 PM 10/13/14
- Event List 2:**
  - 17 4th Floor Elevator Lobby SMOKE DETECTOR FIRE ALARM
- Command Prompt:** Press 'FIRE ACK' to acknowledge 12:25
- Tally Counts:** FIRE=17 PRI2=0 SUPV=0 TRBL=0
- Soft Keys (right side):** Menu, More Info, Site, Event Time, Clr/Exit

**TALLY COUNTS** list the number of activities per category of Fire Alarm (FIRE), Primary 2 Alarm (PRI2), Supervisory (SUPV), and Trouble (TRBL)

**COMMAND PROMPT** advises the operator of the action required and displays local panel time



**MOST RECENT** advises of the time, date, device type, and custom label of the most recent occurrence of the list shown, in this case, the Fire Alarm list

## Site Plan with Event Icons

**Site Plan Bitmap.** The InfoAlarm Command Center supports a site plan monochrome bitmap image (size is 281 pixels wide by 192 pixels high) that can also display icons indicating activity and location. Shown to the right is a sample site plan with icons shown in each building area. For this example, each area is showing an “A” for an initiating device in alarm, a “WF” for waterflow occurring, and an icon indicating notification appliances in alarm. (Icons can be created for site specific symbology, these are for example only.)

**Site Plan Selection and Detail.** If desired, the site plan can be the primary display screen for system activity or can be for reference, available by selecting the “Site” softkey. Depending on the facility layout, the site plan can also be a convenient location for common reference information such as primary call phone numbers, street address, etc. to assist operators in their assigned response.

**System Normal Screen.** The site plan (or another bitmap image) can be displayed on the System Normal screen as a grey image watermark behind the screen text. (Size and type are the same as that for a site plan bitmap). This can be used to identify the specific location of the 4010ES or can display a site-specific logo or other information. (A sample is shown on page 6.)

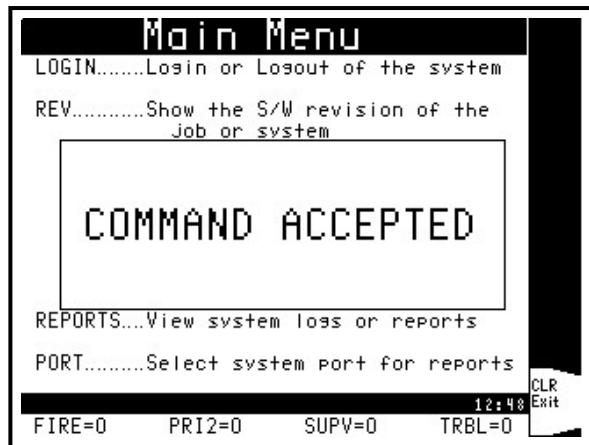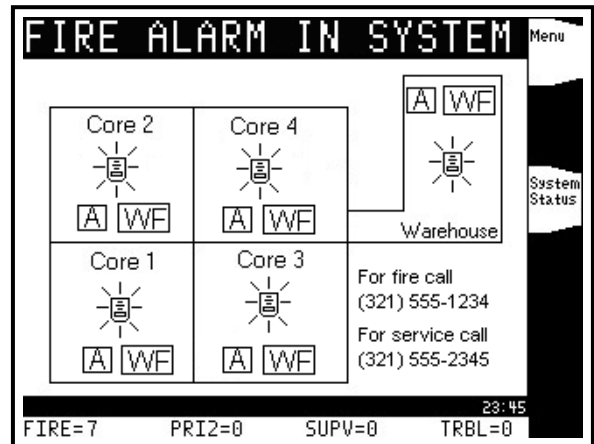


## Customized Emphasis

The Main Menu screen illustration to the left demonstrates how print/display statements appear for status information or for prompting of user input. Other examples of this format occur when setting time and date, entering a password, or identification of a status change such as point enabling or disabling. Use of this feature allows the display to clearly focus the user on required information or actions.

## Information Review


The Trouble Log History screen shown to the right identifies the ability to view multiple event entries with minimal scrolling. For specific information access, pressing “Next” or “Previous” on the keypad highlights the selected next or previous item in the list as indicated by the arrow and the bolded first line of Entry 6.

For access to the next or previous full screen of information, use the Page Dn or Page Up keys located to the right of the soft keys, each to the right of the display.

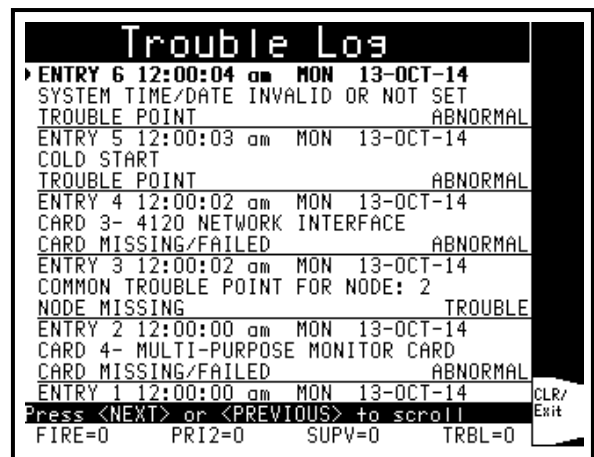

## Additional Primary Display Screens

Below are samples of a First and Most Recent primary display and of a General Alarm display.

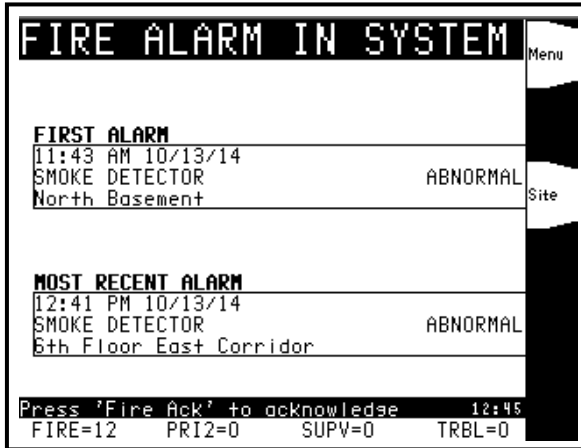


First and Most Recent Primary Display Option



General Alarm Primary Display Option

## International Display Details

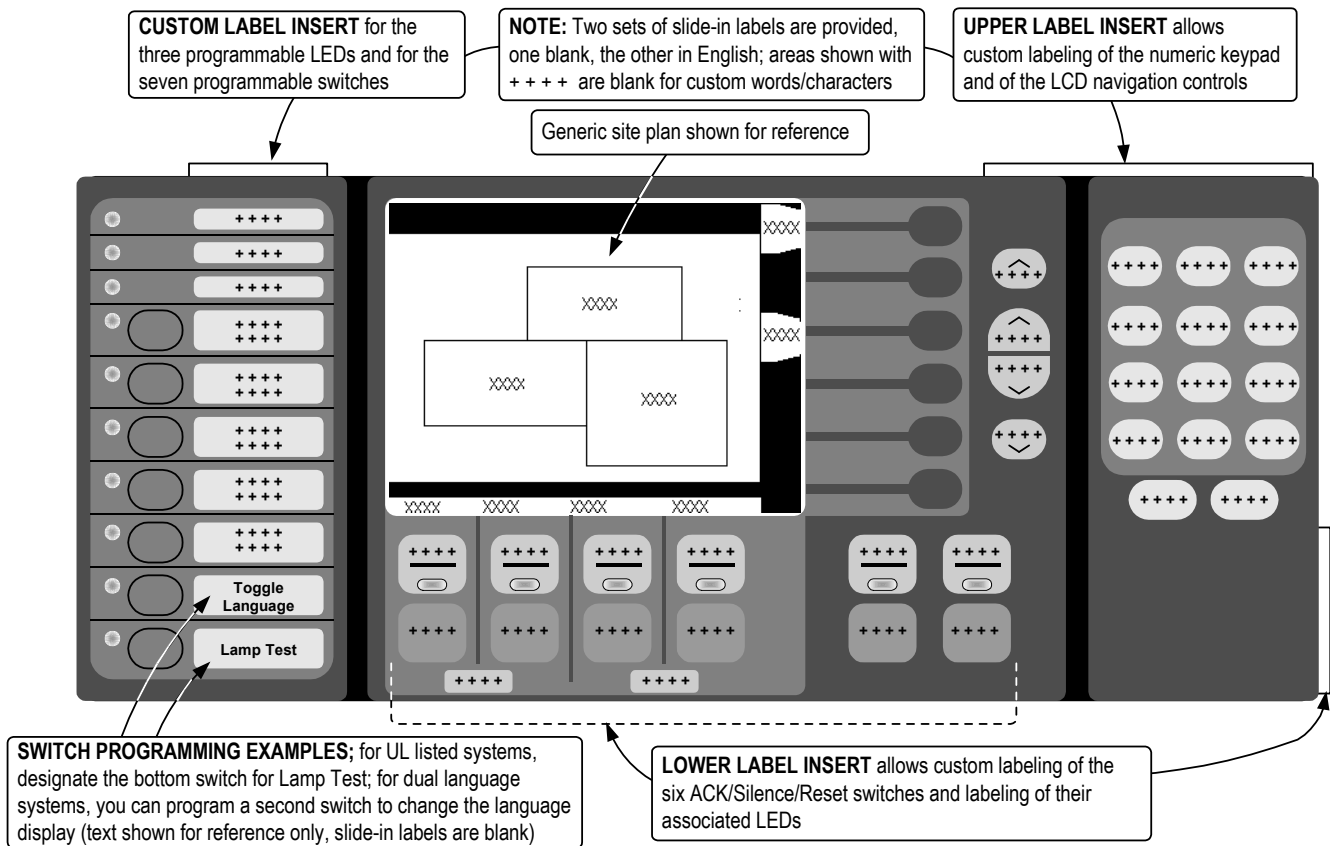

## Remote InfoAlarm Command Center Product Selection


### Remote InfoAlarm Command Center Control Assembly with Cabinet for Surface Mounting

Model Number/Cabinet Color		Application Type	Listing	Description
Red	Platinum			
4100-9401	4100-9403	English	UL & ULC	<b>Remote InfoAlarm Command Center with cabinet;</b> for surface mounting; includes mounting box and door assembly with glass insert; uses RUI communications; requires external 24 VDC system voltage; see illustrations below and Installation Instructions 579-687 for details
4100-9421	4100-9423	French/Canada	ULC	
4100-9441	4100-9443	International	UL	

### Remote InfoAlarm Command Center Front View



### Remote InfoAlarm Command Center Mounting Reference

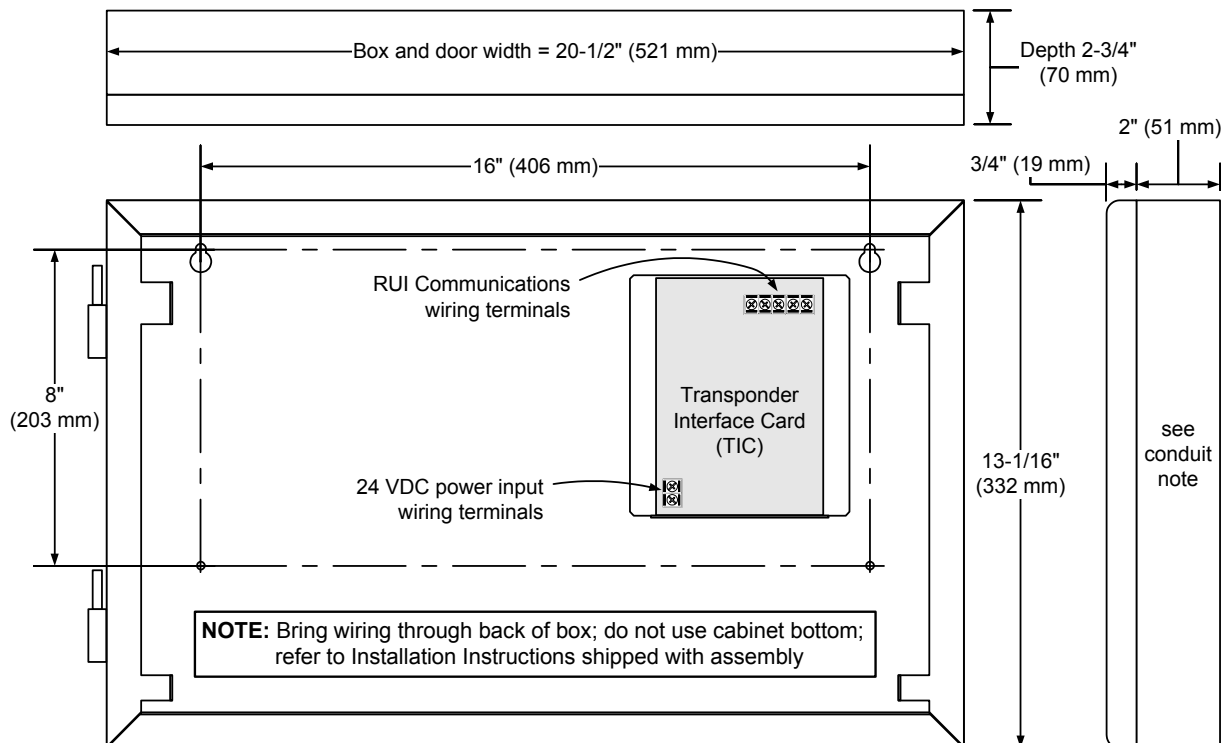

## Specifications

### General Display Specifications

Size Reference	Dot Matrix Size	320 x 240
	Active Display Area	4.53" W x 3.4" H (115 mm x 86 mm), includes header, footer, and softkey area; 5.66" diagonal measurement (144 mm)
	Characters	Up to 854 characters total using standard ASCII character font
	Designation	QVGA; one quarter of standard VGA (Video Graphics Array) display
Display Polarizer Type		Transflective with rear backlight
Display Adjustment		Contrast adjustment is located on the controller module
Backlight		White LEDs with intensity adjustment and selectable AC power fail operation; intensity adjustment is located on the controller module
Backlighting Operation Options		On continuously; Off with AC power fail until a switch is pushed; selectable timeout without switch activity

### Remote Annunciators with InfoAlarm Command Center, Powered from Control Panel

Voltage		19 to 33 VDC (24 VDC nominal), system supplied; requires separate wiring
Current	Supervisory	186 mA @ 24 VDC
	Alarm	214 mA @ 24 VDC; backlight and tone-alert on
Mounting Details; Stand-Alone Cabinet Models		See page 7 for reference illustration
4010ES Capacity, RUI Output	Type	RUI (Remote Unit Interface) external annunciator communications line SLC (signaling line circuit)
	Capacity	Up to 10 Remote InfoAlarm Command Center devices, up to 20 internal and external card addresses per 4010ES
Wiring Requirements	Data	Unshielded Twisted Pair, 18 to 12 AWG (0.82 mm <sup>2</sup> to 3.31 mm <sup>2</sup> ) wires
	Power	18 to 12 AWG (0.82 mm <sup>2</sup> to 3.31 mm <sup>2</sup> ) wires for 24 VDC system power
	Earth	A dedicated earth ground connection to the electrical box is required for proper ESD and EMI protection; wire in accordance with NFPA 70 ( <i>National Electrical Code</i> ) Article 250
	Resistance and Capacitance	0.58 µF (580 nF) maximum capacitance between conductors; 35 Ω maximum total line resistance
Distance	Class X wiring	Up to 2500 ft (762 m)
	Class B "T-Tap" wiring	Up to 10,000 ft (3048 m) total wiring; up to 2500 ft (762 m) to farthest device

### Custom Point Detail Messages

Message Location Details		Select "more info" softkey when investigating point detail and scroll to the bottom of the information; typical messages might include contact details (phone numbers, pager numbers, etc.) and other contact or reference information
Number of Messages		Up to 50
Message Size	Character Details	120 characters; visible characters = 116; (lines 1 and 2 require one carriage return character and one line feed character)
	Line Details	3 lines total; 40 characters maximum per line; line 3 may be limited to 36 visible characters depending on characters in lines 1 and 2
Environmental	Operating Temperature	32° to 120°F (0° to 49° C)
	Operating Humidity	Up to 93% RH, non-condensing @ 90° F (32° C) maximum

### Additional Data Sheet Reference

Data Sheet	Subject	Data Sheet	Subject
S4010-0004	Standard Panel Reference	S4010-0005	Agent Release Applications

*TYCO, SIMPLEX, and the product names listed in this material are marks and/or registered marks. Unauthorized use is strictly prohibited. National Electrical Code and NFPA are trademarks of the National Fire Protection Association.*



Tyco Fire Protection Products • Westminster, MA • 01441-0001 • USA

S41010-0008-3 2/2015

[www.simplex-fire.com](http://www.simplex-fire.com)

© 2015 Tyco Fire Protection Products. All rights reserved. All specifications and other information shown were current as of document revision date and are subject to change without notice.